


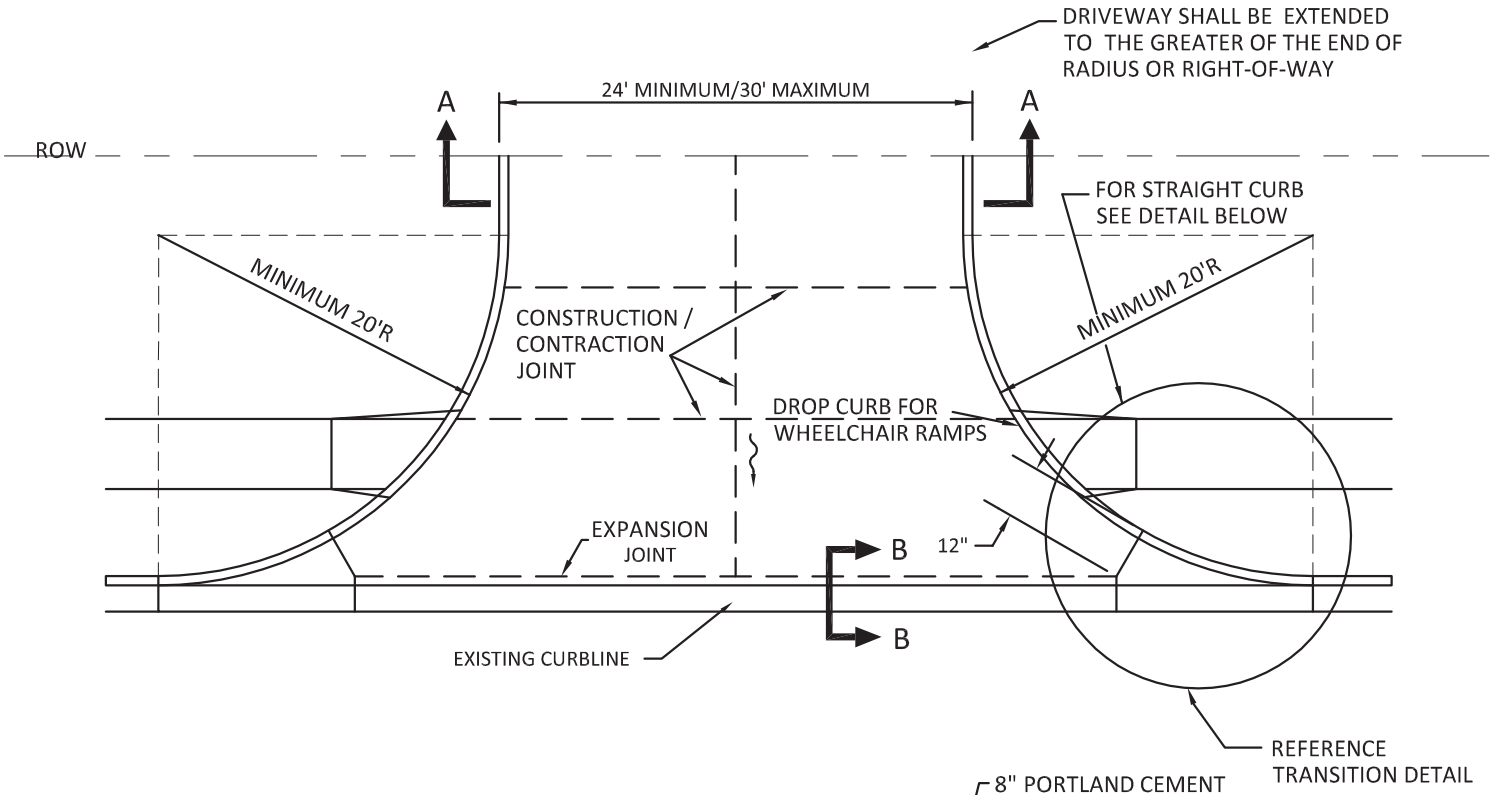


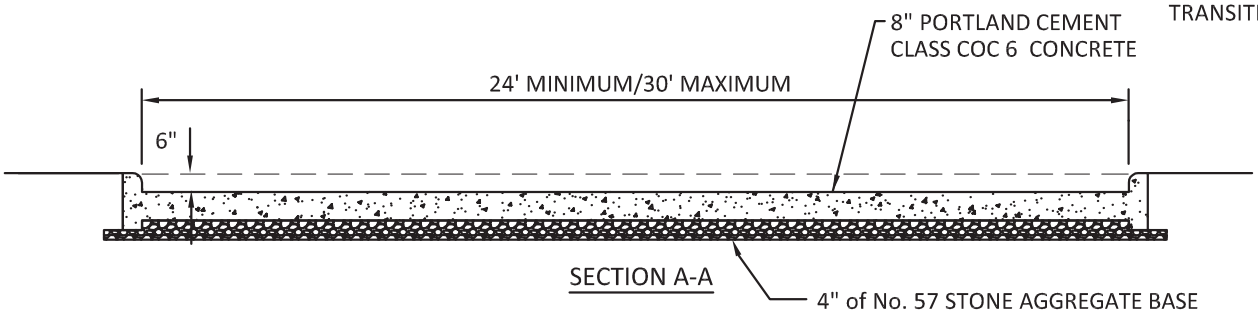

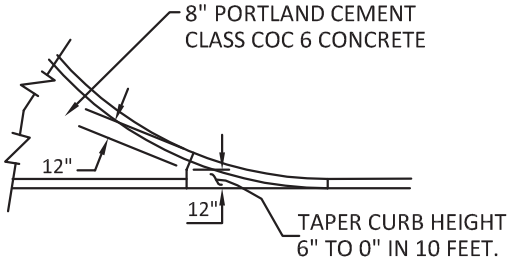

TRANSITION DETAIL

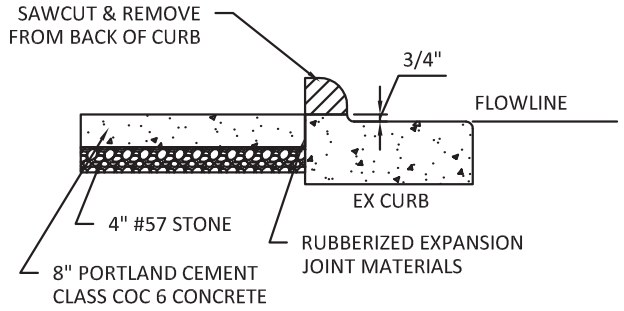

SECTION B - B

NOTES:

1. RUBBERIZED EXPANSION JOINT MATERIAL SHALL BE ½-INCH REFLEX RUBBERIZED EXPANSION JOINT MATERIAL OR APPROVED EQUAL AND PLACED WHEREVER NEW CONCRETE WALK ABUTS A DRIVEWAY APPROACH, AROUND STRUCTURES, AGAINST THE BACK OF CURB, AND AT A MAXIMUM TRANSVERSE INTERVALS OF 30-FT. FOARMTECH CONCRETE EXPANSION JOINT FOAM OR AN APPROVED EQUIVALENT SHALL BE USED AROUND RADII.
2. COMMERCIAL CONCRETE DRIVEWAY APPROACH AND CURB SHALL BE 8-INCH PORTLAND CEMENT, CLASS COC 6 CONCRETE
3. DRIVEWAY APPROACH AND CURB SHALL BE POURED INTEGRAL
4. 4" UNDERDRAIN AND CONCRETE GUTTER SHALL BE MAINTAINED AT THE EXISTING CURBLINE.

EST 1808
CITY OF DELAWARE OHIO
Public Works Department

STANDARD DETAIL

NEW COMMERCIAL CONCRETE DRIVEWAY APPROACH

ROADWAY

RDWD-10.0

Revised 12/31/2018