

Public Works Department

CITY OF DELAWARE OHIO EST 1808


TYPICAL SIDEWALK AND DRIVEWAY APPROACH

STANDARD DETAIL

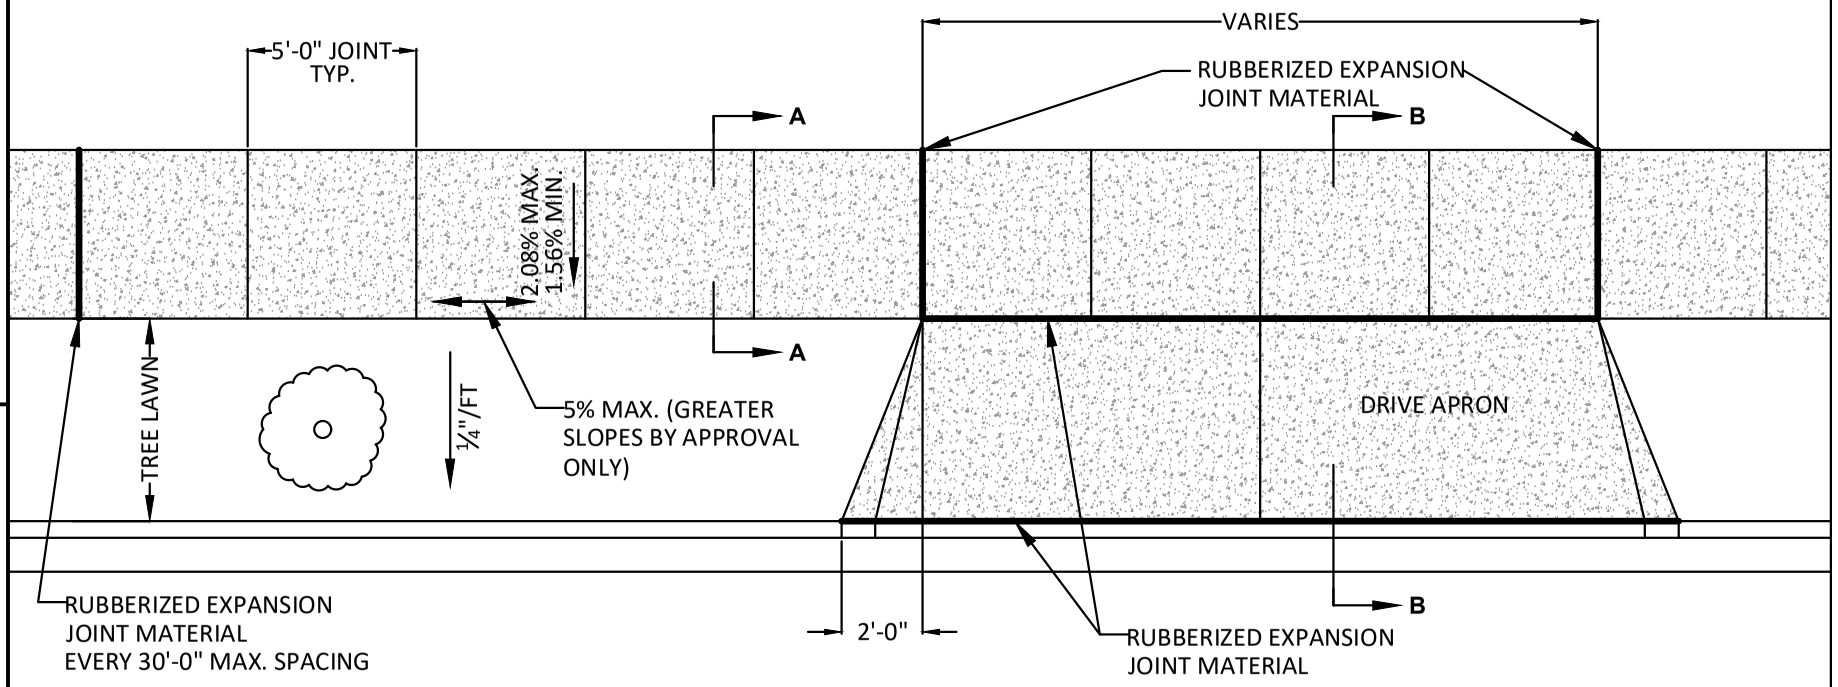

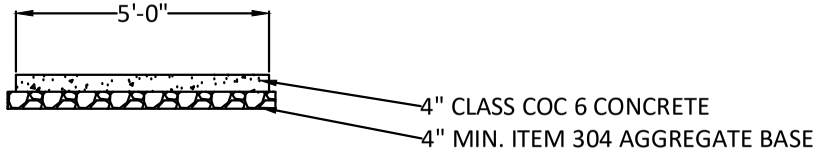

CROSS SECTION A-A

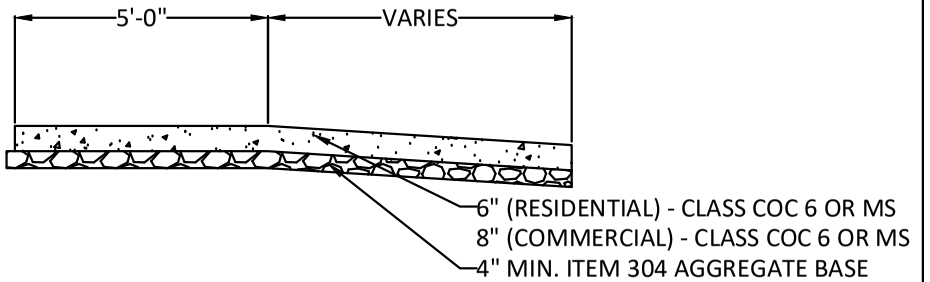

CROSS SECTION B-B

NOTES:

1. RUBBERIZED EXPANSION JOINT MATERIAL SHALL BE 1/2-INCH REFLEX RUBBERIZED EXPANSION JOINT MATERIAL OR APPROVED EQUAL AND PLACED WHEREVER NEW CONCRETE WALK ABUTS A DRIVEWAY APPROACH, AROUND STRUCTURES, AGAINST THE BACK OF CURB, AND AT A MAXIMUM TRANSVERSE INTERVALS OF 30-FT. FOARMTECH CONCRETE EXPANSION JOINT FOAM OR AN A EQUIVALENT SHALL BE USED AROUND RADII.
2. SIDEWALK POURED IN CONJUNCTION WITH DRIVEWAY SHALL HAVE 1/4 -INCH RADIUS EDGE TOOLED JOINTS AND EDGES WITH A BROOM FINISH PERPENDICULAR TO THE DIRECTION OF TRAVEL. RUBBERIZED EXPANSION JOINT MATERIAL IS NOT REQUIRED WITH MONOLITHIC POUR BETWEEN SIDEWALK AND DRIVEWAY.

ROADWAY

RDWD-19.3

9/19/2025