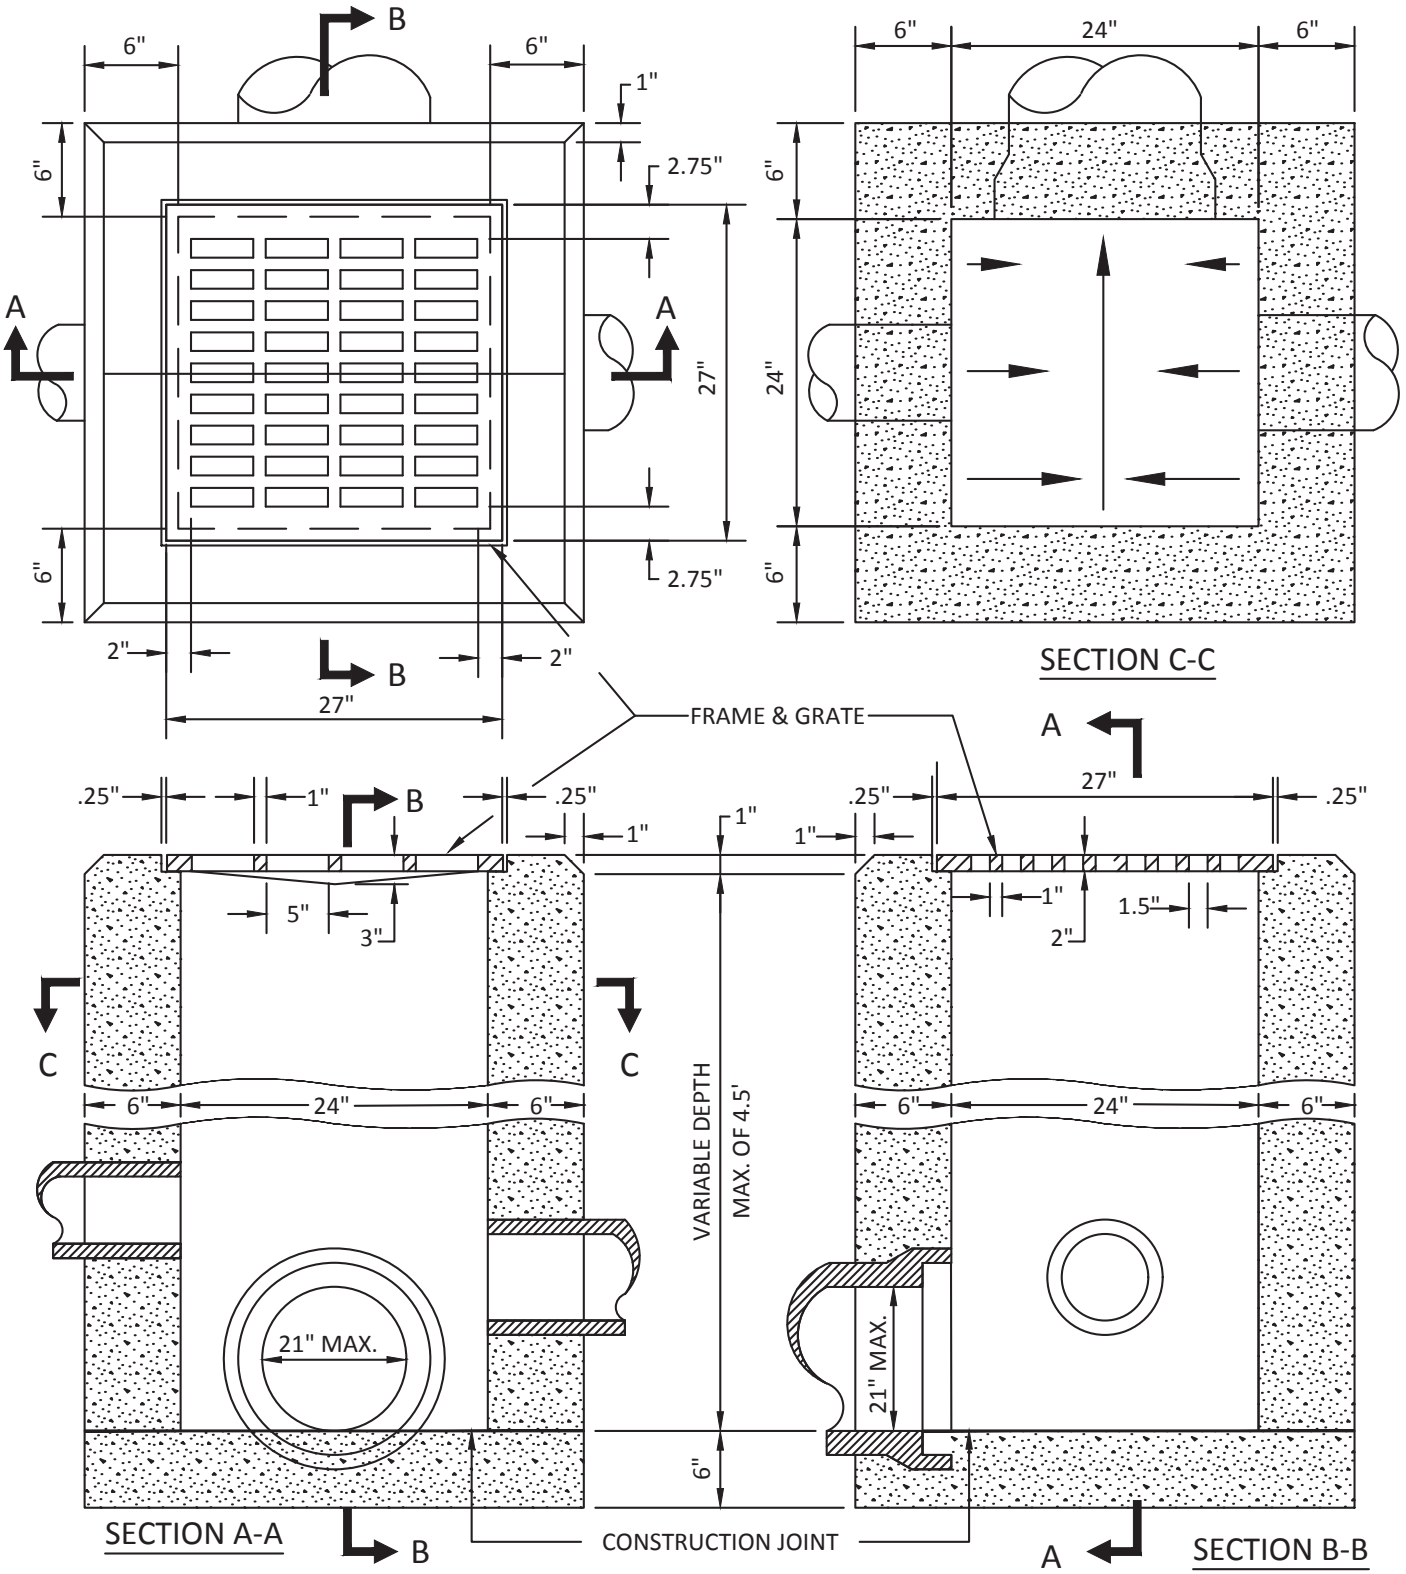


NOTES:

1. ALL BASINS TO BE PRECAST CONCRETE WITH MINIMUM WALL THICKNESS OF 6 INCHES AND BE REINFORCED SUFFICIENTLY TO PERMIT SHIPPING AND HANDLING WITHOUT DAMAGE.
2. GRATE SHALL BE EAST JORDAN IRON WORKS 5115M2, NEENAH 4852, OR APPROVED EQUAL.
3. IN NON-TRAFFIC APPLICATIONS GRATE MAY BE USED WITHOUT A FRAME. IN TRAFFIC APPLICATIONS, USE ANGLE FRAME, EAST JORDAN IRON WORKS 5115Z, NEENAH 1883-0018, OR APPROVED EQUAL.

EST 1808
CITY OF
DELAWARE
OHIO
Public Works Department

STANDARD DETAIL

STANDARD 2-FT x 2-FT CATCH BASIN

UTILITIES

SEWD-10.0

Rev. 12/31/2018