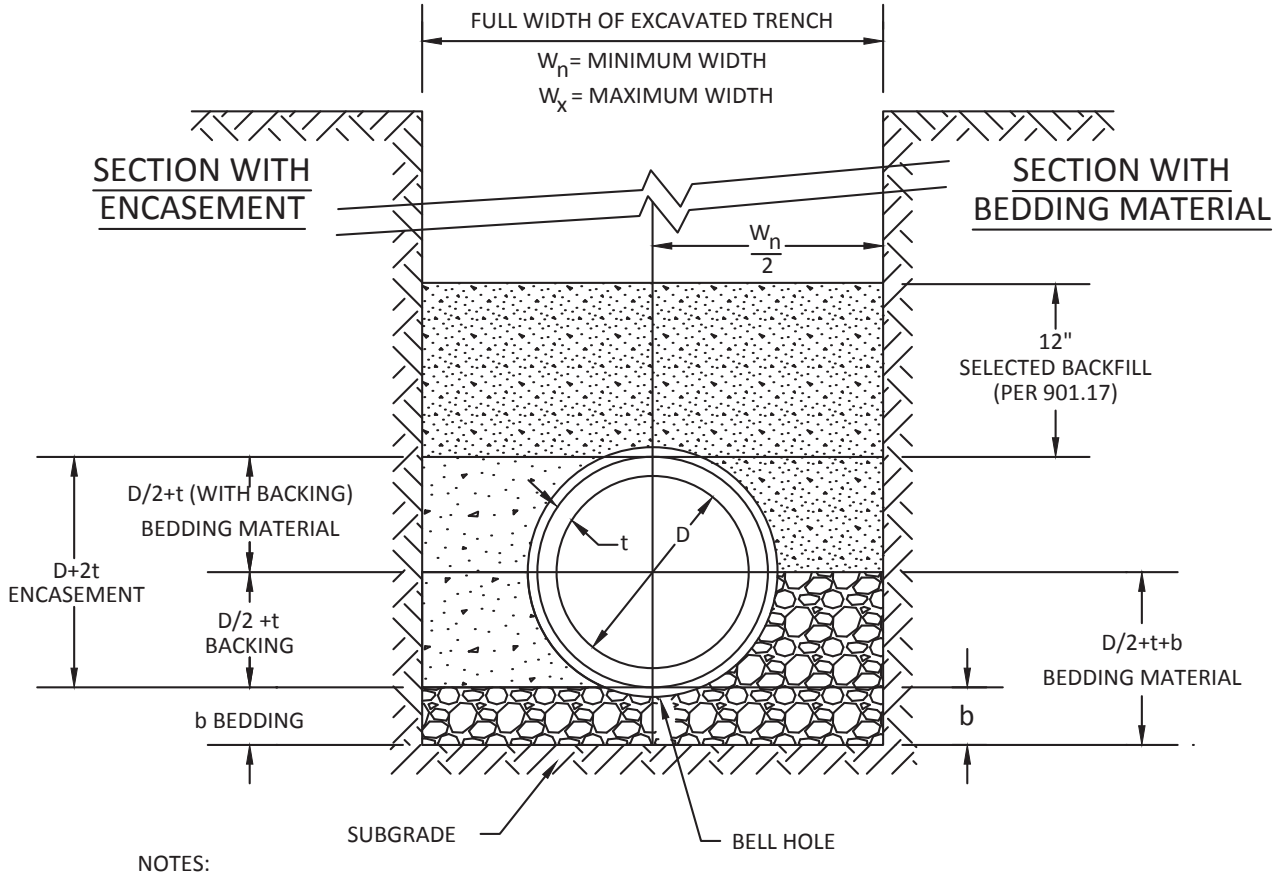


NOTES:

1. SECTION SYMMETRICAL ABOUT C/L
2. *DIMENSIONS ARE EXPRESSED IN INCHES.
3. BACKING OR ENCASEMENTS TO BE CLASS "A" CONCRETE, ITEM 905.
4. ON SANITARY SEWER CONSTRUCTION TRENCH DAMS ARE REQUIRED AS SPECIFIED UNDER 901.11.
5. PAYMENT FOR CONCRETE BACKING AND ENCASEMENT SHALL BE BASED ON MINIMUM TRENCH WIDTH (W_n).

SMALL DIAMETERS
b = 4"

D*	W_n*	W_x*
6	24	48
8	27	48
10	30	48
12	32	48
15	36	50
18	40	53
21	44	57
24	48	60
27	52	64

MID DIAMETERS
b = 6"

D*	W_n*	W_x*
30	57	67
33	61	71
36	64	74
42	71	81
48	78	88
54	87	95
60	96	102
66	105	127

LARGE DIAMETERS
b = 6"

D*	W_n*	W_x*
72	116	134
78	123	141
84	130	148
90	136	155
96	143	162
102	151	169
108	160	176

EST 1808
CITY OF DELAWARE OHIO
Public Works Department

STANDARD DETAIL

TYPE 1 BEDDING

FOR RIGID SEWER PIPE 6-INCHES TO 108-INCHES DIAMETER

UTILITIES

SEWD-13.0

Rev. 12/31/2018