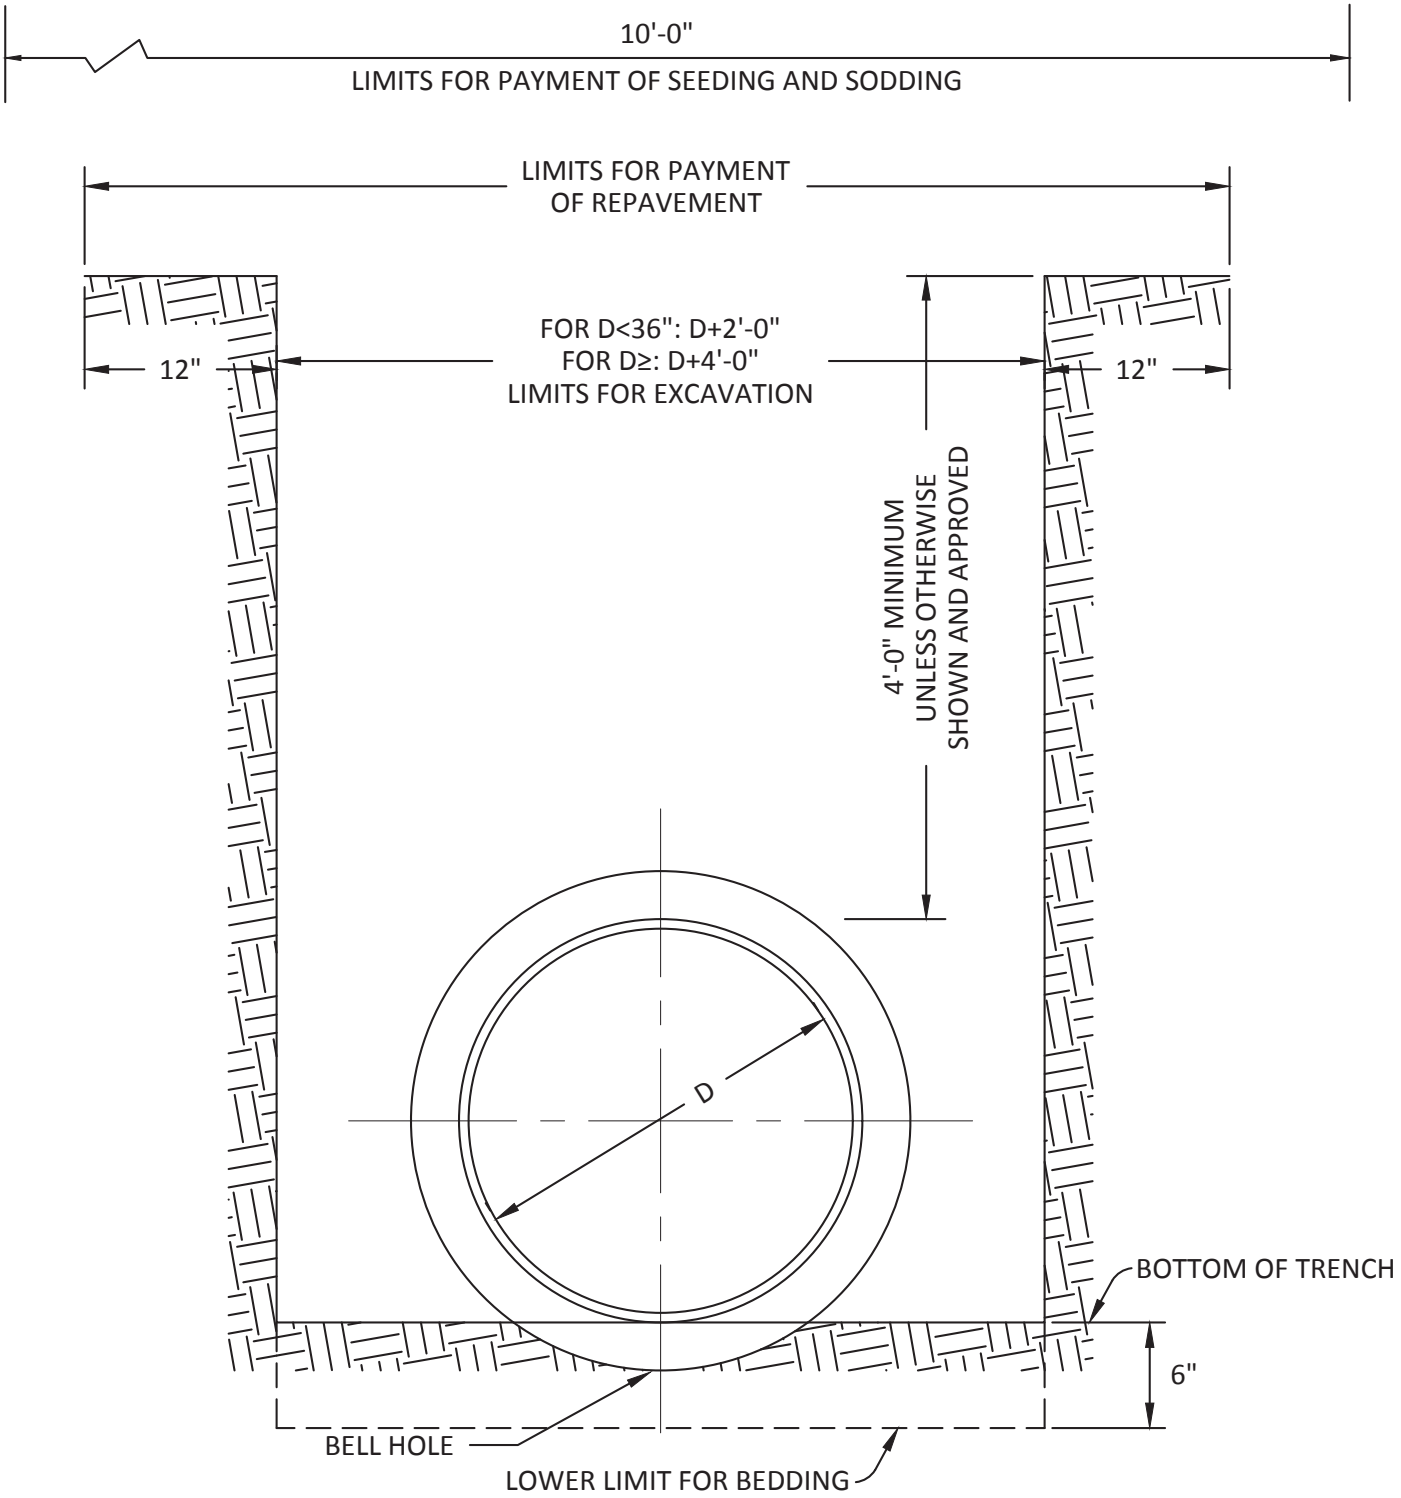


NOTES:

1. FOR 16" DIAMETER AND SMALLER WITH 10' OR LESS DEPTH OF COVER, PROVIDE 6" BEDDING IF ROCK OR UNSUITABLE MATERIAL IS FOUND AT THE BOTTOM OF TRENCH EXCAVATION.
2. FOR 16" DIAMETER AND SMALLER WITH OVER 10' DEPTH OF COVER, PROVIDE 6" BEDDING.
3. FOR ALL PIPE LARGER THAN 16" DIAMETER, PROVIDE 6" BEDDING.
4. BEDDING SHALL BE NO. 57 STONE.

EST 1808 CITY OF DELAWARE OHIO Public Works Department	STANDARD DETAIL TYPICAL WATER TRENCH	WATER WTRD-15.0 Rev. 12/31/2018