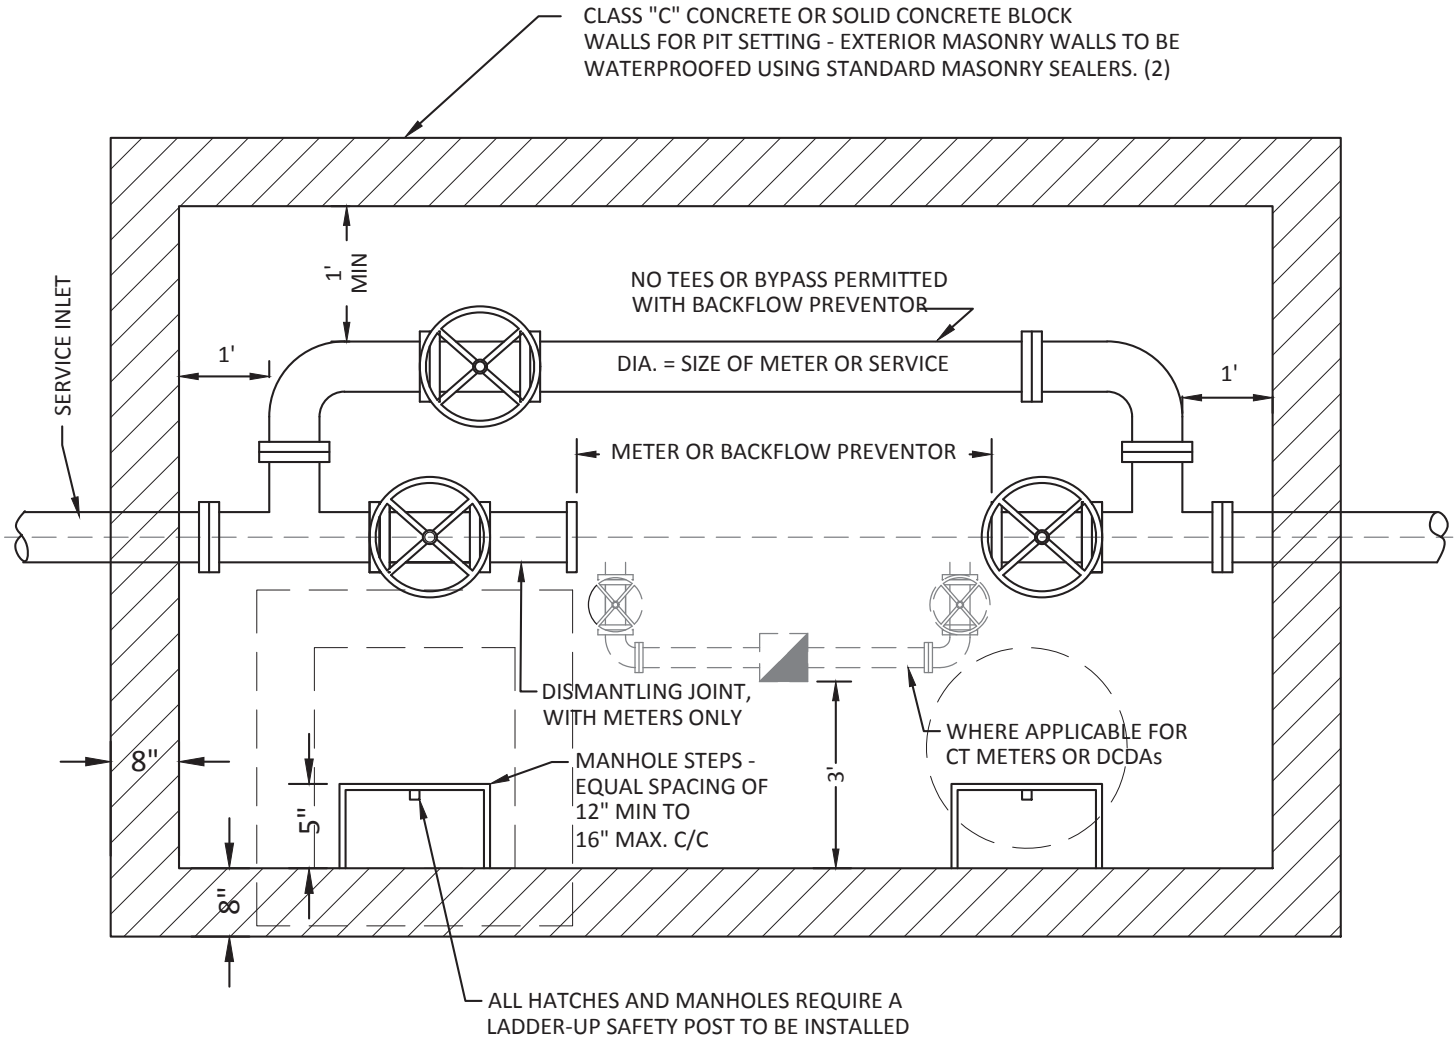


NOTES:

1. METERS SHALL BE EITHER A COMPOUND TURBINE (BADGER OR APPROVED EQUAL) OR ULTRASONIC (OCTAVE BY MASTER METER OR APPROVED EQUAL), AND SHALL BE APPROVED BY THE PUBLIC UTILITIES DEPARTMENT.
2. BACKFLOW PREVENTORS SHALL BE ASSE 1048 COMPLIANT DOUBLE CHECK DETECTOR ASSEMBLYS (DCDA) AND SHALL BE APPROVED BY THE PUBLIC UTILITIES DEPARTMENT.
3. AN APPROVED PRECAST METER PIT MAY BE USED IN LIEU OF A CONSTRUCTED PIT FOR OUTSIDE SETTINGS.
4. PROVIDE A DISMANTLING JOINT BETWEEN THE METER AND VALVE ON THE INLET SIDE, SMITH-BLAIR 971 OR APPROVED EQUAL.

EST 1808 CITY OF DELAWARE OHIO Public Works Department	STANDARD DETAIL METER VAULT 3" TO 12"	WATER WTRD-18.1 Rev. 12/31/2018