

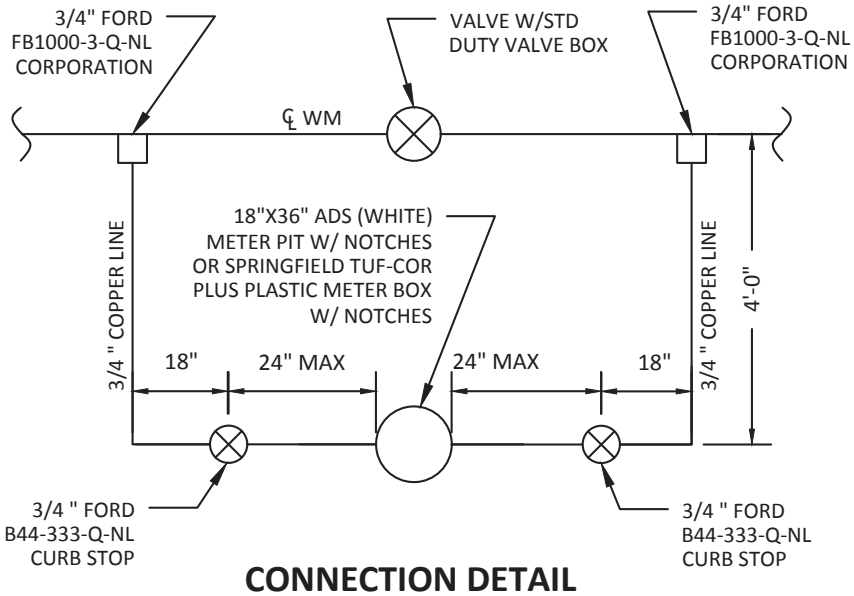


CONNECTION DETAIL

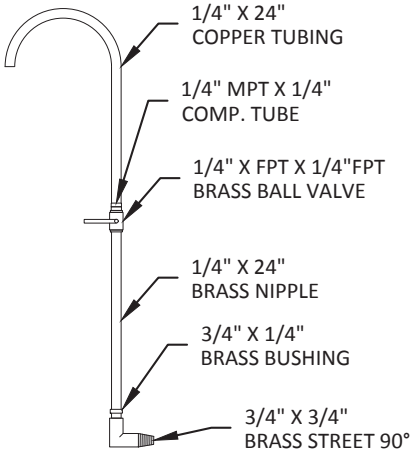

REMOVABLE SAMPLING FIXTURE FOR INSPECTION

CONTRACTOR SHALL PROVIDE TO CITY, DO NOT INSTALL IN PIT.

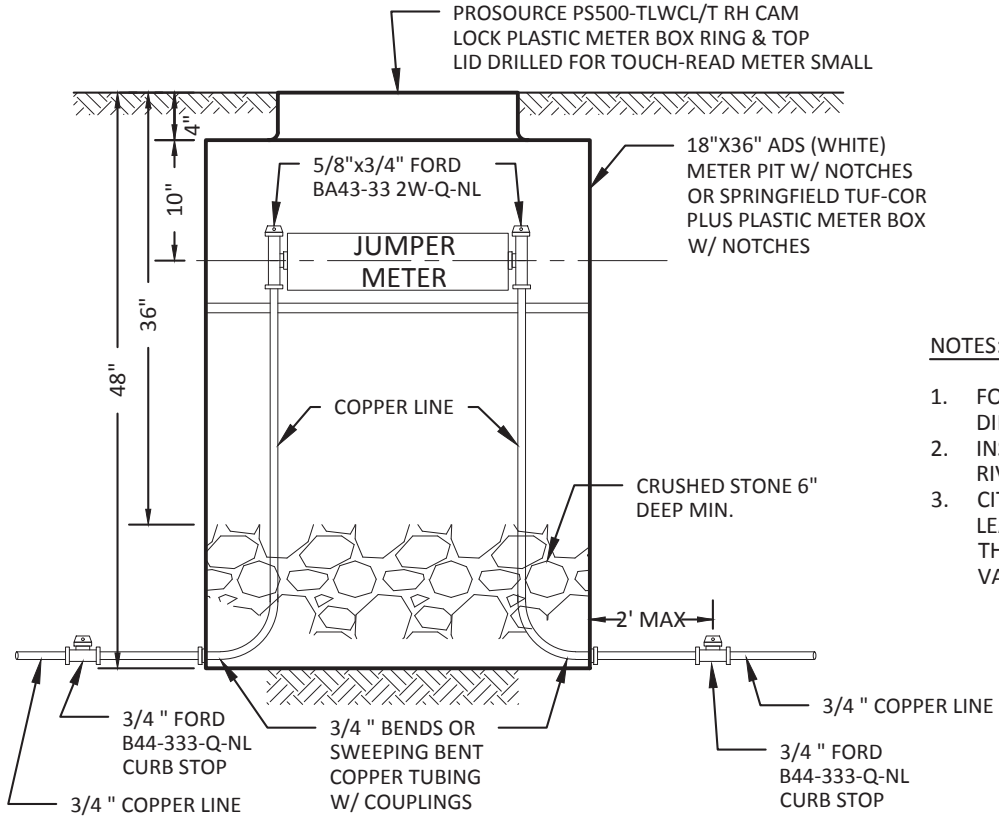

NOTES:

1. FOR USE AT RIVER CROSSINGS OR WHERE DIRECTED BY THE CITY.
2. INSTALLATON TO BE ON SUPPLY SIDE OF RIVER CROSSING.
3. CITY TO PROVIDE METER WHEN TESTING FOR LEAKGE. CONTRACTOR SHALL INSTALL THREADED PLUGS INTO THE METER ANGLE VALVES AT TIME OF CONSTRUCTION.

INSPECTION METER PIT DETAIL

EST 1808
CITY OF
DELAWARE
OHIO
Public Works Department

STANDARD DETAIL

INSPECTION METER PIT DETAILS

WATER

WTRD-19.0

Rev. 12/31/2018